





MGA 56

40.0 m Horiz.

5.0 m Vert.

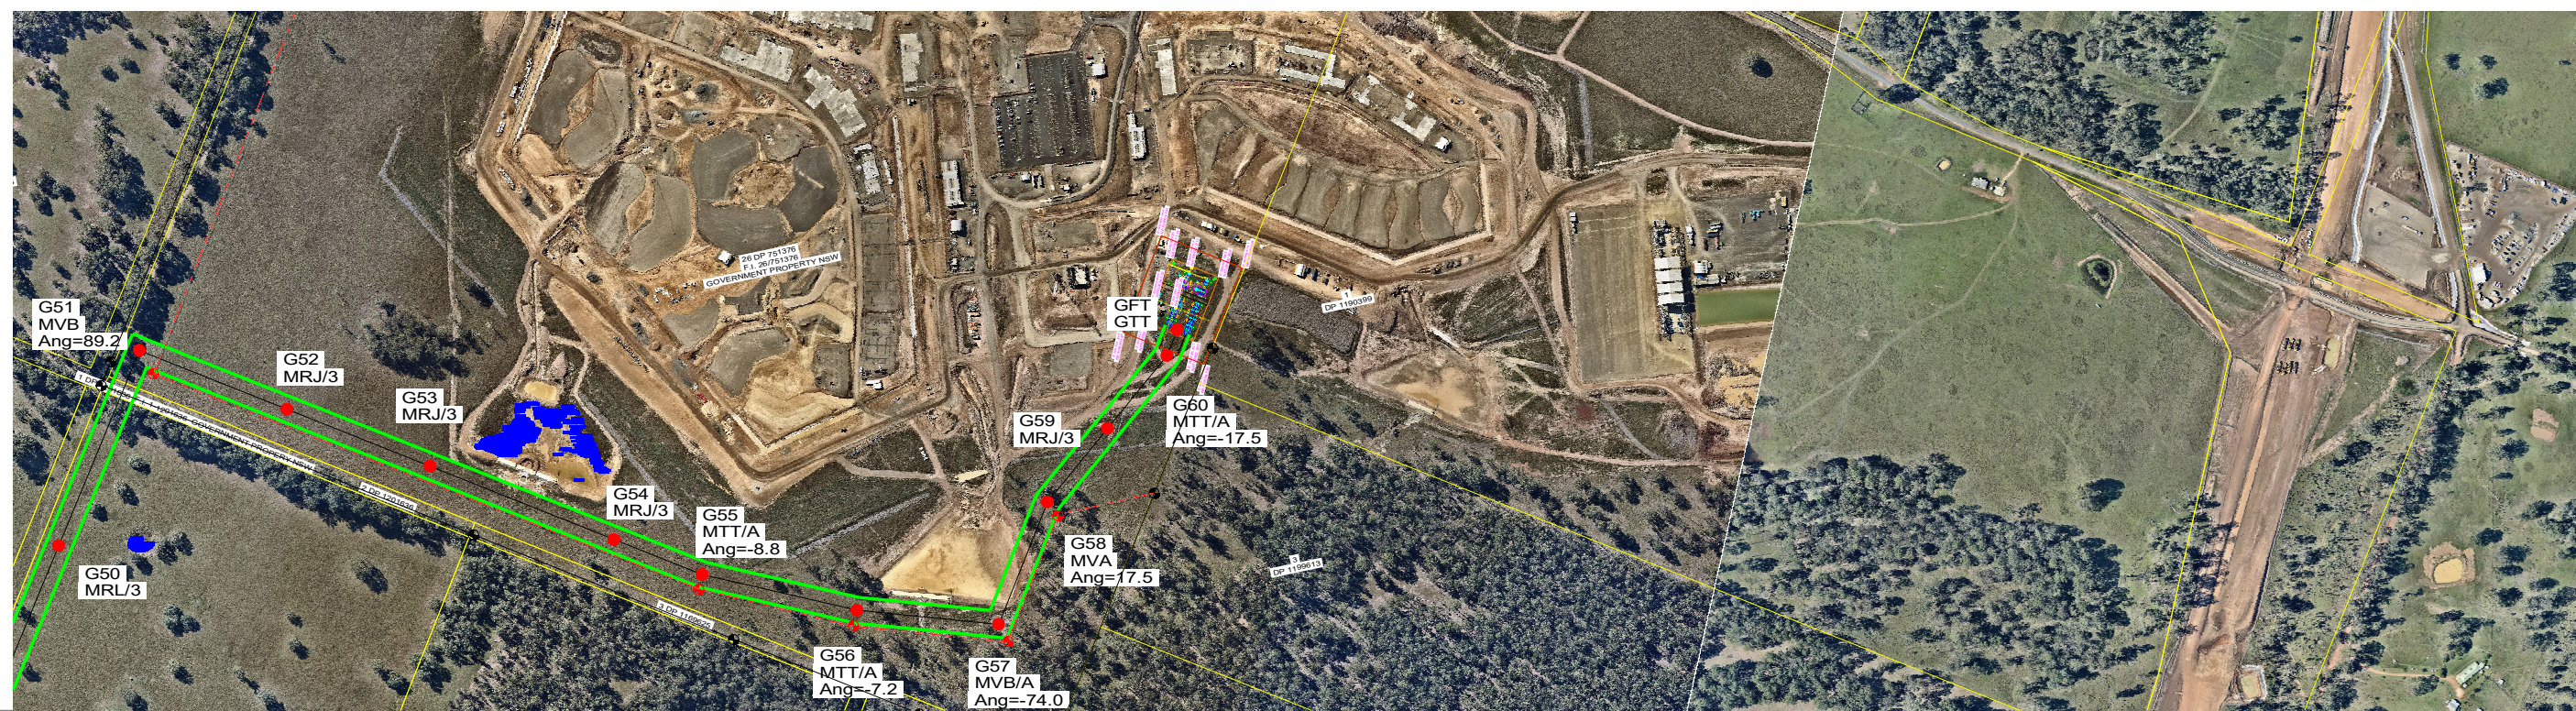

- NOTES:
1. CONDUCTORS DISPLAYED @ 85°C.
 2. EARTHWIRES DISPLAYED @ -5°C.
 3. GROUND CLEARANCE LINE DISPLAYED @ 7.5m.
 4. SIDE PROFILE DISPLAYED @ +/-3m.
 5. EASEMENT WIDTH = 30m.

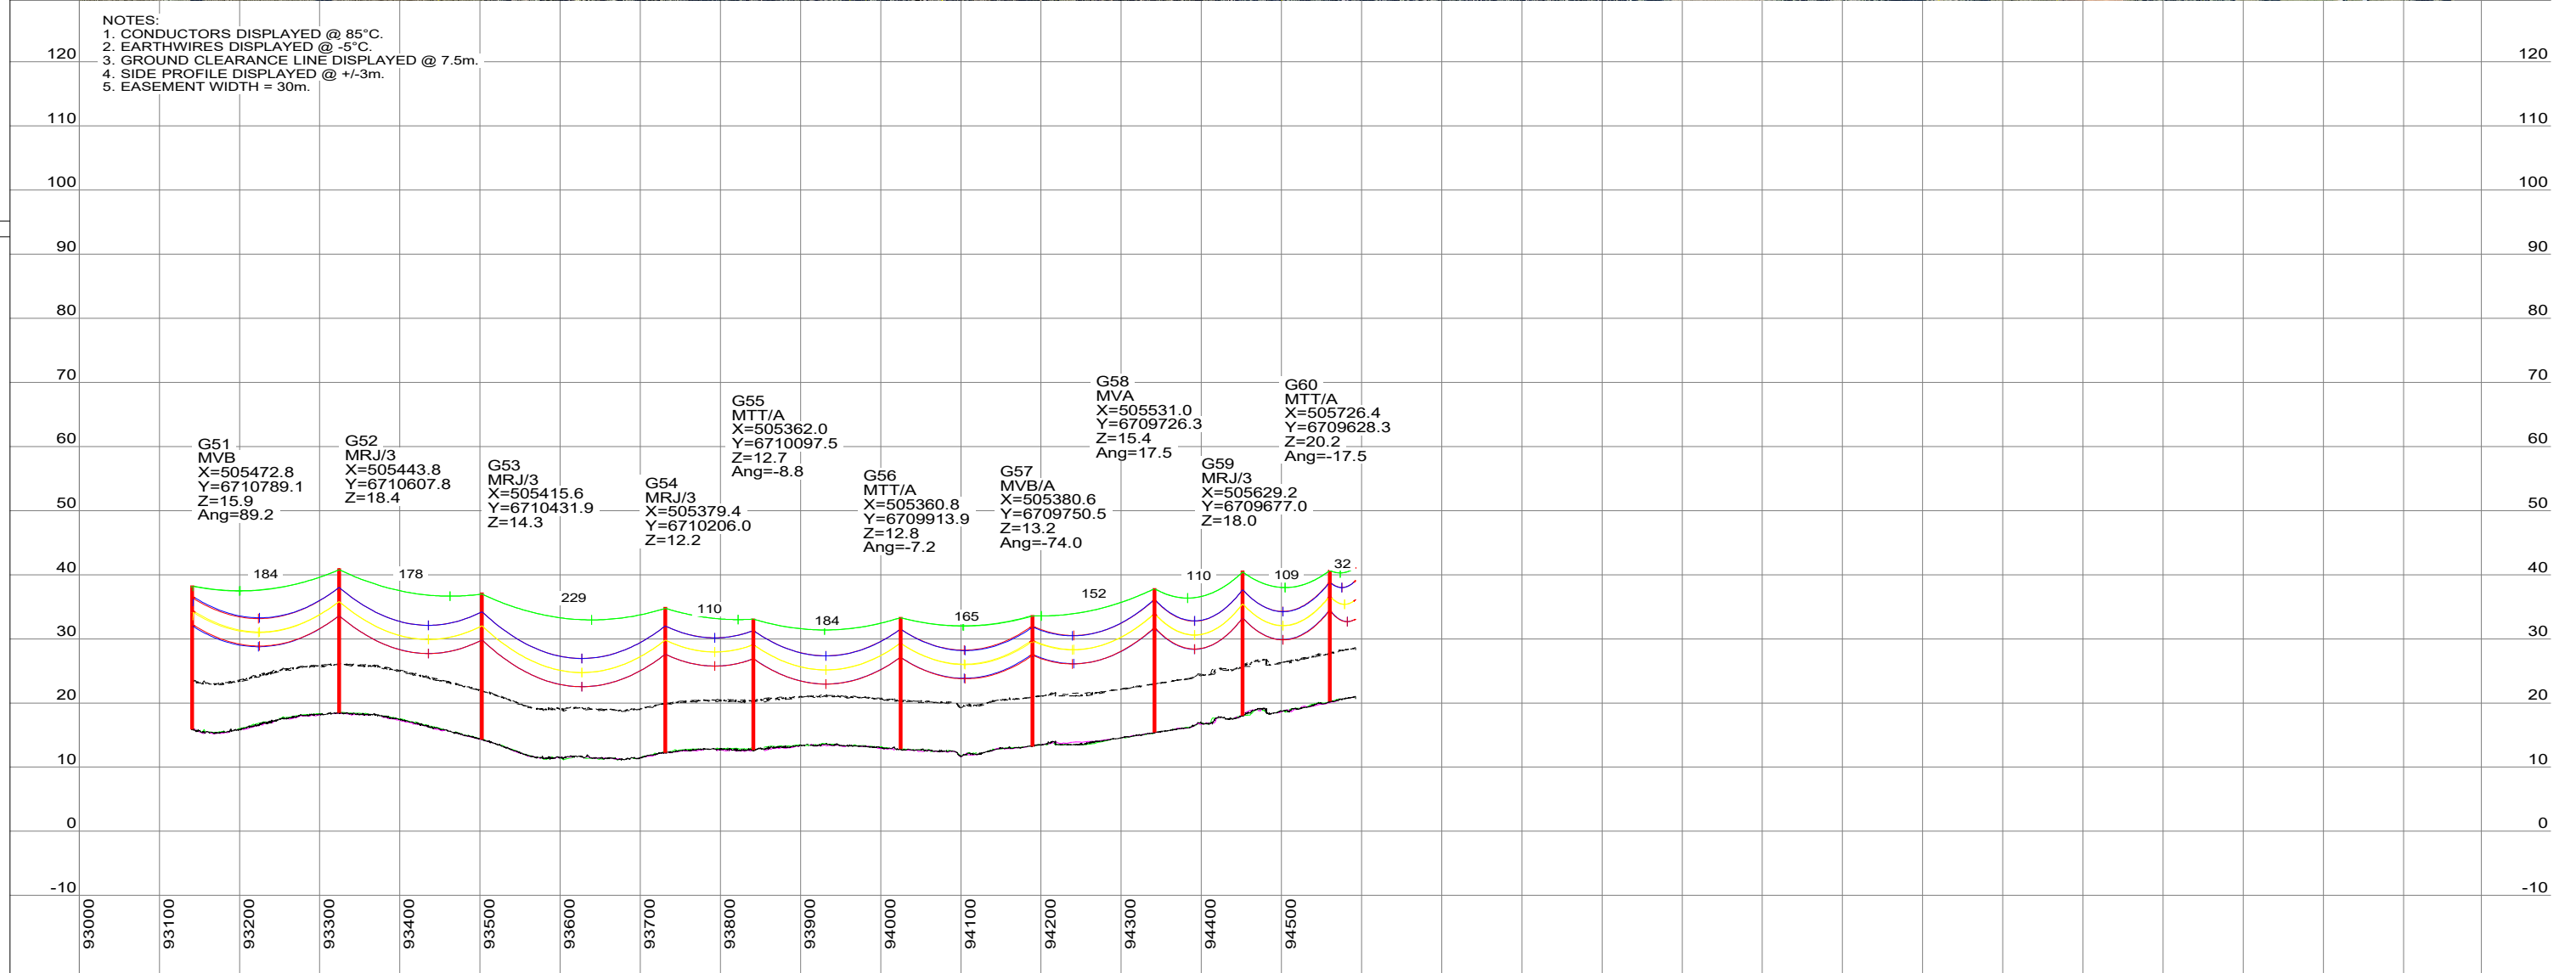

This drawing is copyright and is the property of TransGrid. No part of this work may be copied, reproduced, altered or amended, stored in a retrieval system, or transmitted in any form or by any means without the prior permission in writing of TransGrid.

AMENDMENT TEXT:



DRAWN	NDB	06/03/2019	TransGrid	
REVIEWED			TRANSMISSION LINES	
VERIFIED			TL SURVEY - PROFILE	
APPROVED			132kV TL96H - COFFS HARBOUR TO KOOLKHAN	
ISSUED FOR INFORMATION			GRAFTON EAST CONNECTION	
APPROVAL STATUS			PLAN AND PROFILE	
A1	TL-900828 / 6	01A	PREFIX	NUMBER SHEET AMDT
SCALE				INDEX CLASSN